


Mass Spectrum

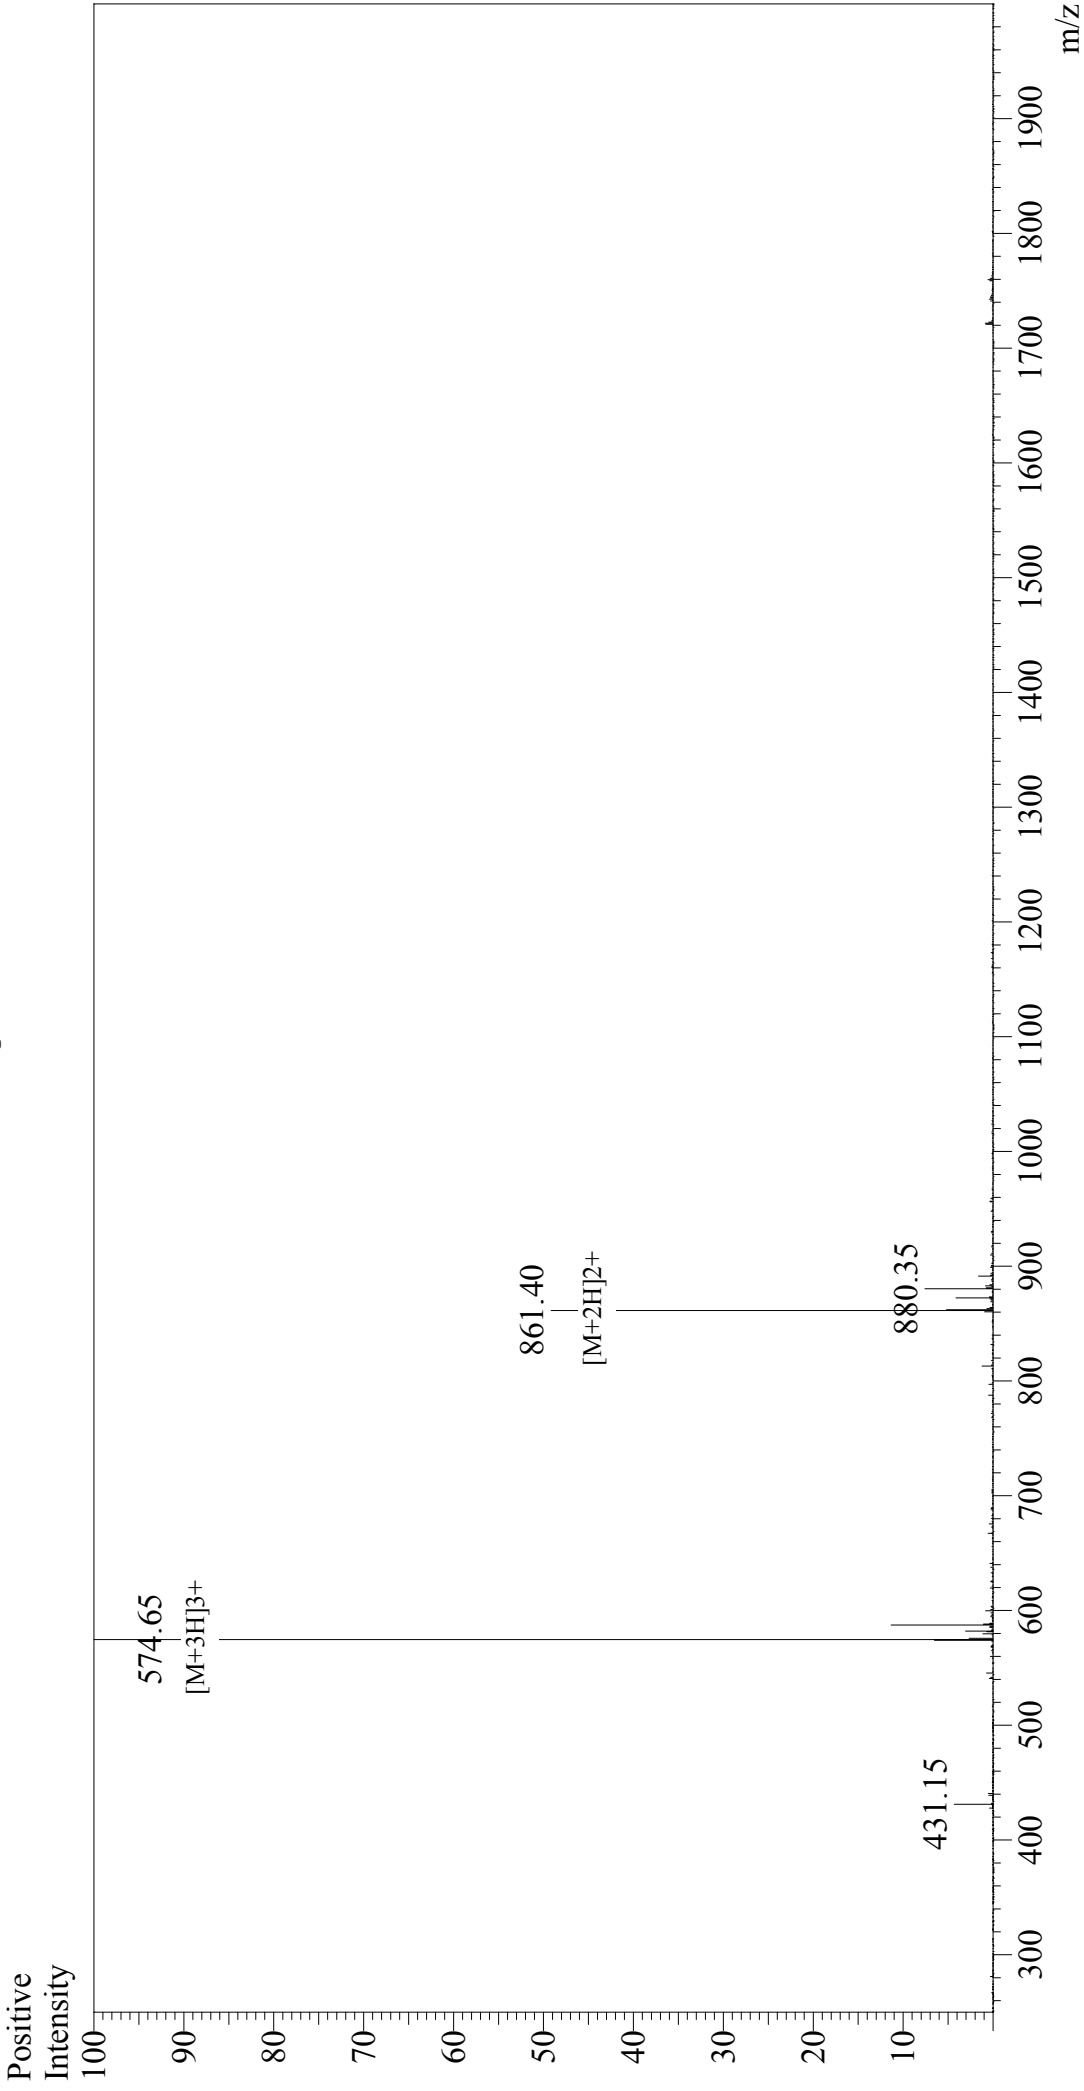

Sample Information

Acquired by : Gary
Month-Day Processed : 09/28/17
Time Processed : 21:38:42
Injection Volume : 0.2
Sample Name : Cortistatin 14, human, rat
Cat No.: RP10972
Lot No.: PE3361709
Theoretical MW : 1721.01
Observed MW : 1720.95

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250°C
Block Temp : 200°C

Interface Bias
Drying Gas Flow
T.Flow
B.conc

: +4.5 kV
: 5 L/min
: 0.2 ml/min
: 50%H2O/50%MeOH